


## FDC (Fire Department Connection)

Vegetation shall have a minimum of a thirty-six (36) inch clearance from the sides and rear of a FDC and the FDC shall be free-and-clear of the street.

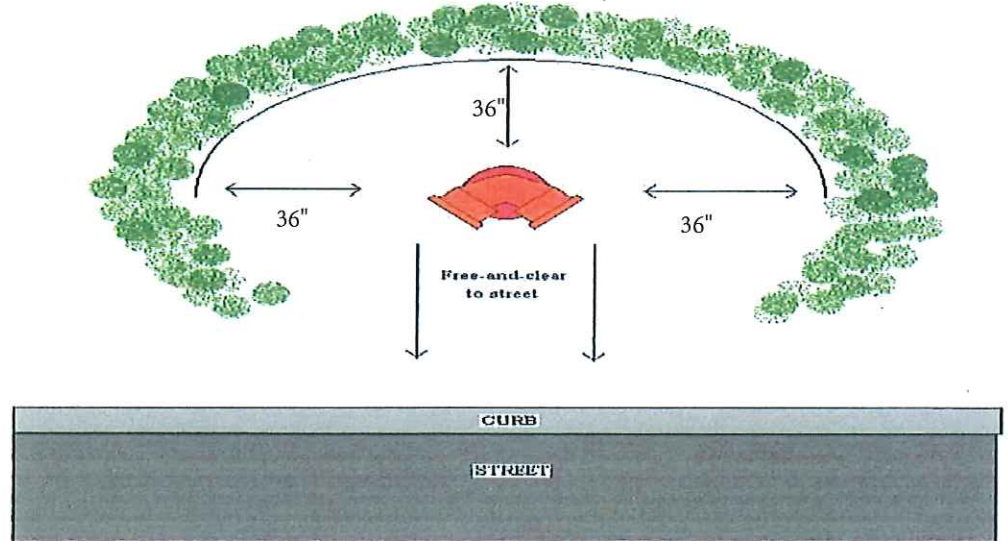

## FIRE HYDRANTS

Vegetation shall have a minimum of a thirty-six (36) inch clearance from the sides and rear of a hydrant and the hydrant shall be free-and-clear to the street. A clear space not less than 60 inches shall be provided in front of each hydrant connection.

